

# QUICK START GUIDE (T119 INSTALLATION NOTES)

## RULES FOR THE CORRECT INSTALLATION OF THE T119 CONTROL UNIT

In order to guarantee the correct and reliable operation of the transformer temperature control system, follow the instructions supplied in this document about the installation of the control unit and the connection of the temperature sensors.

### SAFETY REQUIREMENTS

#### ATTENTION:

Read the manual carefully before starting to use the control unit. Keep the instructions for future reference.



Do not open the device, touching any internal components can cause electric shock. Contact with a voltage over 50 Volts can be fatal. To reduce the risk of electric shock, do not dismantle the device for any reason. Moreover its opening would void the warranty.

Before connecting the device to the power supply, make sure that all the connections are correct. Always disconnect the unit from the supply before any cabling modification.



Any work on the equipment must be entrusted to a qualified engineer.

Failure to comply with these instructions can cause damages, fires or electric shock, and possible serious injuries!

### POWER SUPPLY

The T119 has UNIVERSAL power supply, i.e. it can be supplied by 24 to 240 Vac-Vdc, irrespectively of polarity in Vdc.

Before using it, make sure the power cable is not damaged, knotted or pinched. Do not tamper with the power cable. Never disconnect the unit by pulling the cable, avoid touching the pins. Do not carry out any connecting/disconnecting with wet hands. To disconnect the device, do not use objects such as levers. Immediately disconnect the device if you smell burning or see any smoke: contact technical service.

### LIQUIDS

Do not expose the equipment to splashes or drops, do not position it in places with humidity exceeding 90% and never touch with wet or humid hands during storms. If any liquid penetrates the control unit, disconnect it immediately and contact technical service.

### CLEANING

Disconnect the power cable before cleaning the control unit, use a dry cloth to dust it, without any solvent or detergents, and compressed air.

### OBJECTS

Never insert any objects into the cracks of the control unit. If this happens, disconnect the control unit and contact an engineer.

### USE RESERVED TO QUALIFIED PERSONNEL

The purchased goods are a sophisticated electronic device that is totally unsuitable to be used by non-qualified personnel. Any work must be carried out by a specialist engineer.

### ACCESSORIES

The use of non-original accessories or spare parts can damage the unit and endanger users' safety. In the event of faults, contact technical service.

## LOCATION

Install the control unit indoors, in a place protected from water splashes and sun rays. Do not place near heat sources exceeding the parameters stated in this manual. Position on a stable surface, far from any possible vibrations. Position the unit as far as possible from any intense magnetic fields.


## REPAIRS

Do not open the control unit. For any fault, always use qualified personnel. The opening of the control unit and/or the removal of the series identifying label entails the automatic forfeiture of the warranty. The Warranty seal is applied to all devices, any attempt to open the unit would break the seal and cause the consequent automatic forfeiture of the warranty.


## FITTING THE CONTROL UNIT

The temperature control unit must be fitted on a panel complying with the following instructions:

- The device is designed to be panel-mounted.
- Do not position the device near any heat sources or strong magnetic fields.
- Operating temperature from -20°C to 60°C.
- Maximum humidity 90% (non-condensing).
- Indoor work environment (protected by splashes and sun rays).
- Make 92X44 mm hole (tolerance +0.8mm) in the panel metal sheet.

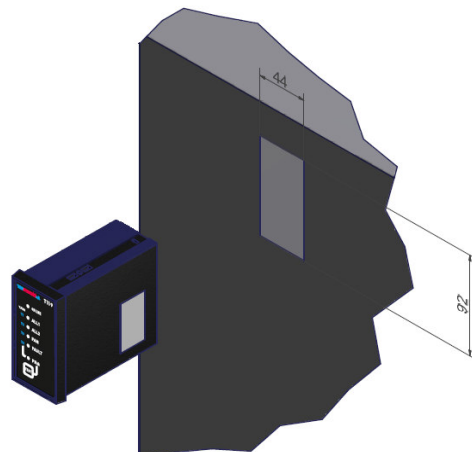

Fix the unit securely with the blocks supplied.

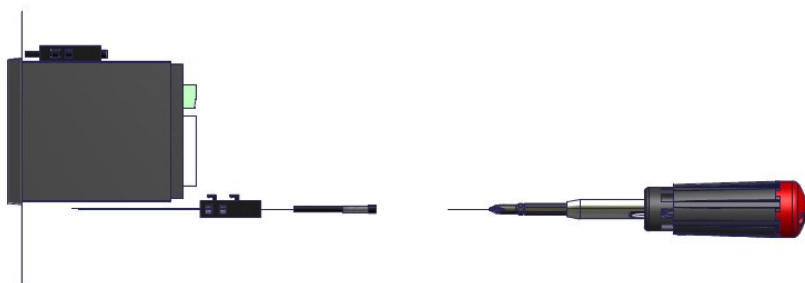


## ELECTRICAL CONNECTIONS



### SENSORS

3 lines inputs for PTC sensor, according to DIN 44081 and 44082 standards.



The T119 control unit has UNIVERSAL POWER SUPPLY, it can be supplied by 24 to 240 Vac-Vdc, 50/60Hz irrespectively of polarity in Vdc (terminals 40-42).


The ground must always be connected to terminal 41.



### RELAYS

Output relay with 5A-250Vac-res COSΦ=1 contacts.

## CONNECTION FROM THE SCS BOX / SENSORS TO THE CONTROL UNIT

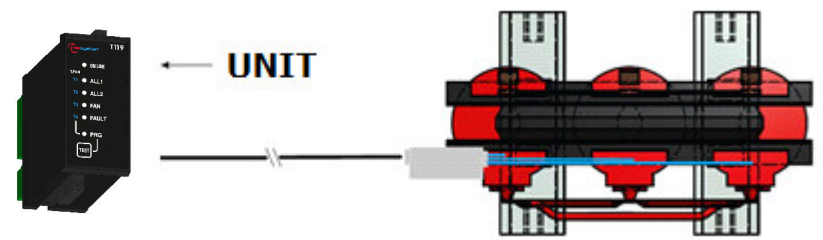

To connect the PTC sensors correctly between the SCS box and the temperature control unit, comply with the following instructions rigorously:

### Installation rules:

- The sensors' signal transfer cable must not be near any electrical cables, either low or medium-high voltage.
- The Ptc cable and the signal transfer cable must be laid in a straight line, without any winding.
- Any caps used to butt conductors must be crimped properly to avoid false contacts.

If you do not comply with the instructions supplied, there may be anomalies in the temperature reading for which TECSYSTEM cannot be held responsible.

## FAN PROGRAMMING CYCLE

- Turn on the unit (the green LED lights up LINE ON)
- Push TEST key twice in sequence (the red PRG LED flashes)
- Push TEST within 5" without releasing it until the PRG LED is ON
- Press TEST once to select 5' (T1 ON)
- Press TEST twice to select 10' (T2 ON)
- Press TEST three times to select 20' (T3 ON)
- Press TEST four times to select 40' (T4 ON)



If you don't need any FAN cycle, push TEST 5 times (all LEDs are OFF). The unit is programmed only for ALL1 and ALL2 (alarm and trip)

Stop pressing TEST when the LED is on the Tx corresponding to the desired time. Wait for all the LEDs to go OFF.

Turn the unit off and then back on.

### LED INDICATION:

LED ON: "ON" The device is powered correctly, "OFF" the device is not powered correctly

ALL1 LED: "ON" L1 trip threshold exceeded, "OFF" temperature below the L1 trip threshold.

ALL2 LED: "ON" L2 trip threshold exceeded, "OFF" temperature below the L2 trip threshold.

FAN LED: "ON" FAN trip threshold exceeded, "OFF" temperature below the FAN trip threshold.

FAULT LED - L1 LED - L2 LED - FAN LED flashing: see PTC SENSOR FAULT DIAGNOSIS on manual at page 10.



### ATTENTION:

We recommend you check the unit's programming before starting the device.

The default parameters set by TECSYSTEM might not match your requirements.

TO DOWNLOAD THE COMPLETE "T119 INSTRUCTION MANUAL", USE\* THE QR CODE ON THE CONTROL UNIT OR CONNECT TO THE TECSYSTEM WEBSITE ([www.tecsystem.it](http://www.tecsystem.it))

### INSTRUCTION



### MANUAL

TECHNICAL INFORMATION : Mail: [ufficiotecnico@tecsystem.it](mailto:ufficiotecnico@tecsystem.it) — tel: 02/4581861

\*download the QR CODE READER application to your smartphone / tablet and you will be ready to read all Q codes