
## **QUICK START GUIDE (T119 DIN INSTALLATION NOTES)**

ELECTRICAL CONNECTIONS RULES FOR THE CORRECT INSTALLATION OF THE T119 DIN CONTROL UNIT In order to guarantee the correct and reliable operation of the transformer temperature control SENSORS L1 L2 F. system, follow the instructions supplied in this document about the installation of the control unit and the connection of the temperature sensors. 3 lines inputs for PTC CH1 CH2 sensor, according to DIN SAFETY REQUIREMENTS CH3 44081 and 44082 standards. 3 1 **ATTENTION:** 24-240 Read the manual carefully before starting to use the control unit. Keep the instructions for future reference. The T119 DIN control unit has UNIVERSAL POWER SUPPLY, it Vac/Vdc can be supplied by 24 to 240 Vac-Vdc, 50/60Hz irrespectively of polarity in Vdc (terminals 40-42) Do not open the device, touching any internal components can cause electric shock. Contact with a voltage over 50 Volts can be fatal. To reduce the risk of electric shock, do not dismantle the device for any 40 41 42 The ground must always be connected to terminal 41. reason. Moreover its opening would void the warranty. ALL1 Before connecting the device to the power supply, make sure that all the connections are correct. Always disconnect the unit from the supply before any cabling modification. FAULT ALL2 FAN RELAYS Any work on the equipment must be entrusted to a qualified engineer. Output relay with 5A-250Vac-res የ Failure to comply with these instructions can cause damages, fires or electric shock, and possible Ŷ Ŷ COSΦ=1 contacts. serious injuries! 5 67 8 9 10 11 12 POWER SUPPLY The T119 DIN has UNIVERSAL power supply, i.e. it can be supplied by 24 to 240 Vac-Vdc, irrespectively of CONNECTION FROM THE SCS BOX / SENSORS TO THE CONTROL UNIT polarity in Vdc. Before using it, make sure the power cable is not damaged, knotted or pinched. Do not tamper with the power cable. Never disconnect the unit by pulling the cable, avoid touching the pins. Do not carry out any connecting/disconnecting with wet hands. To disconnect the device, do not use objects such as levers. Immediately disconnect the device if you smell burning or see any smoke: contact technical service. UNIT LIQUIDS Do not expose the equipment to splashes or drops, do not position it in places with humidity exceeding 90% and never touch with wet or humid hands during storms. If any liquid penetrates the control unit, disconnect it immediately and contact technical service. CLEANING Disconnect the power cable before cleaning the control unit, use a dry cloth to dust it, without any solvent or detergents, and compressed air. To connect the PTC sensors correctly between the SCS box and the temperature control unit, comply with **OBJECTS** the following instructions rigorously: Never insert any objects into the cracks of the control unit. If this happens, disconnect the control unit and contact an engineer. USE RESERVED TO QUALIFIED PERSONNEL Installation rules: The purchased goods are a sophisticated electronic device that is totally unsuitable to be used by The sensors' signal transfer cable must not be near any electrical cables, either low or mediumnon-qualified personnel. Any work must be carried out by a specialist engineer. high voltage. ACCESSORIES The Ptc cable and the signal transfer cable must be laid in a straight line, without any winding. The use of non-original accessories or spare parts can damage the unit and endanger users' safety. In the Any caps used to butt conductors must be crimped properly to avoid false contacts. event of faults, contact technical service. If you do not comply with the instructions supplied, there may be anomalies in the temperature reading for which TECSYSTEM cannot be held responsible. LOCATION FAN PROGRAMMING CYCLE Install the control unit indoors, in a place protected from water splashes and sun rays. Do not place near Turn on the unit (the green LED lights up LINE ON) heat sources exceeding the parameters stated in this manual. Position on a stable surface, far from any Push TEST key twice in sequence (the red PRG LÉD flashes) possible vibrations. Position the unit as far as possible from any intense magnetic fields. ≻ Push TEST within 5" without releasing it until the PRG LED is ON Press TEST once to select 5' (T1 ON) REPAIRS Press TEST twice to select 10' (T2 ON) ≻ Do not open the control unit. For any fault, always use qualified personnel. The opening of the control unit Press TEST three times to select 20' (T3 ON) and/or the removal of the series identifying label entails the automatic forfeiture of the warranty. The Press TEST four times to select 40' (T4 ON) Warranty seal is applied to all devices, any attempt to open the unit would break the seal and cause the consequent automatic forfeiture of the warranty. If you don't need any FAN cycle, push TEST 5 times (all LEDs are OFF). The unit is programmed only for ALL1 and ALL2 (alarm and trip) FITTING THE CONTROL UNIT Stop pressing TEST when the LED is on the Tx corresponding to the desired time. Wait for all the LEDs to go OFF The temperature control unit must be fitted on a panel complying with the following instructions: Turn the unit off and then back on. The device is designed to be DIN track mounting Do not position the device near any heat sources or strong magnetic fields. LED INDICATION: Operating temperature from -20°C to 60°C Maximum humidity 90% (non-condensing) LED ON: "ON" The device is powered correctly, "OFF" the device is not powered correctly Indoor work environment (protected by splashes and sun rays) L1 LED: "ON" L1 trip threshold exceeded, "OFF" temperature below the L1 trip threshold. Dimension 106x90 mm DIN43880 depth 58mm. L2 LED: "ON" L2 trip threshold exceeded, "OFF" temperature below the L2 trip threshold. FAN LED: "ON" FAN trip threshold exceeded, "OFF" temperature below the FAN trip threshold. Dimensions of the unit: FAULT LED - L1 LED - L2 LED - FAN LED flashing: see PTC SENSOR FAULT DIAGNOSIS on manual at page 10.

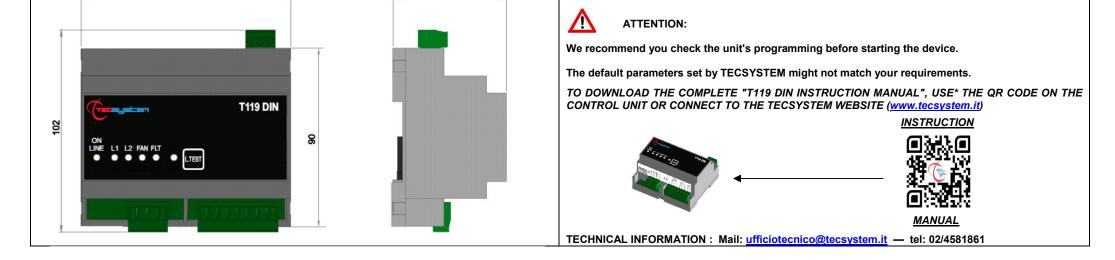

\*download the QR CODE READER application to your smartphone / tablet and you will be ready to read all Q codes

106

Sede amministrativa -Offices&Factory- Via Leonardo da Vinci, 54/56 - 20094 Corsico (MI) - Italy Tel. +39 024581861 - Fax +39 0248600783 www.tecsystem.it

58